

NPC Internal Joint Seal

Technical Specifications

1. Scope


This specification describes the function of the NPC Internal Seal, its principle of operation, and the component materials that constitute the Internal Seal and their physical properties.

2. Product Application

NPC Internal Joint Seals are designed to seal leaking pipe joints in most types of pipe including concrete, reinforced concrete, cast iron, ductile iron, steel, vitrified clay, PVC and HDPE. They are designed to withstand external head pressure of 30 feet (13 psi).


3. Principle of Operation

NPC Internal Joint Seals stop leaking joints by bridging the joint with a flexible rubber seal and compressing the rubber seal against the inside diameter of the pipe on either side of the joint with expansion bands.

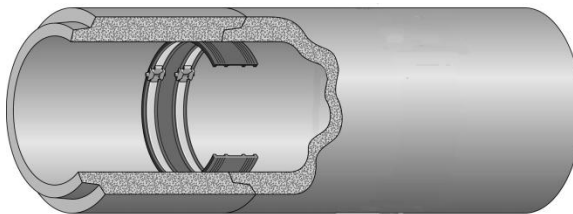

The compressive force providing the seal on either side of the joint is the result of increasing the effective diameter of the stainless steel expansion bands.

The diameters of the expansion bands are increased by tightening the bolts on the WedgeLock Assemblies. This forces the



corresponding wedges, which are attached to the expansion bands, away from each other increasing the expansion band diameter. Depending on the diameter of the pipe joint being sealed, there will be between one and four WedgeLock Assemblies on each expansion band to ensure an even distribution of compressive force on the rubber seal.

4. Materials

The NPC Internal Joint Seal is manufactured in compliance with the material requirement of ASTM C923, consisting of a high quality flexible rubber seal, 300 series stainless steel expansion bands and WedgeLock assemblies.

Flexible Rubber Seal - The seal is extruded from a high grade rubber compound to the required length, and the ends are joined using a high strength vulcanized splice.

Internal Expansion Bands - The Expansion Bands are manufactured from 300 series, non-magnetic, stainless steel, which conforms to the material requirements of ASTM C923.

Reference NPC Internal Seal Recommended Installation Procedure for a detailed explanation of the preparation, assembly and installation of the Internal Seal.

NPC Internal Joint Seal

Technical Specifications

ASTM C-923 MATERIAL PROPERTIES

Physical Property	ASTM Specification	Test Requirement
Chemical Resistance 1N Hydrochloric Acid 1N Sulfuric Acid	D543, at 22 °C for 48 Hours	No weight loss
Tensile Strength	D412	1200 psi
Elongation at Break	N/A	350% minimum
Hardness	D2240 (Shore A Durometer)	+/- 5 from manufacturer's specified hardness
Accelerated Aging	D573 70 °C for 7 days	Maximum Decrease: 15% tensile, 20% elongation
Water Absorption	D471, immerse 0.75 by 2 inch specimen in distilled water at 70 °C for 48 hours.	10% weight increase maximum
Ozone Resistance	D1171	Rating 0
Low Temp. Brittle Point	D746	No fracture at -40 °C
Tear Resistance	D624, method B	200 lbf/in.



Trelleborg Pipe Seals Milford, Inc.
250 Elm Street, P.O. Box 301, Milford, NH 03055 U.S.A
Tel: 603-673-8680 800-626-2180 Fax: 603-673-7271 www.trelleborg.com/npc